

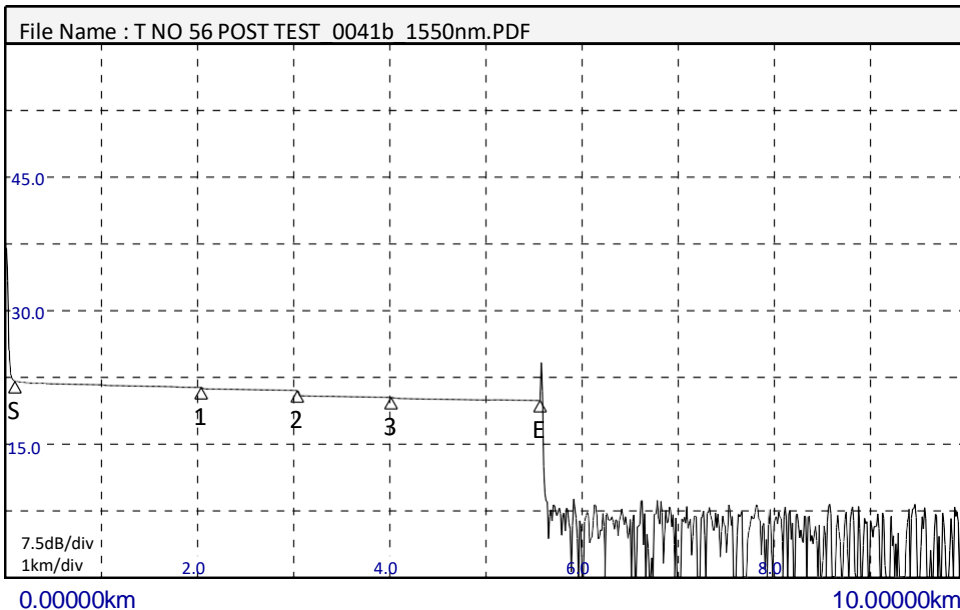


Link Report

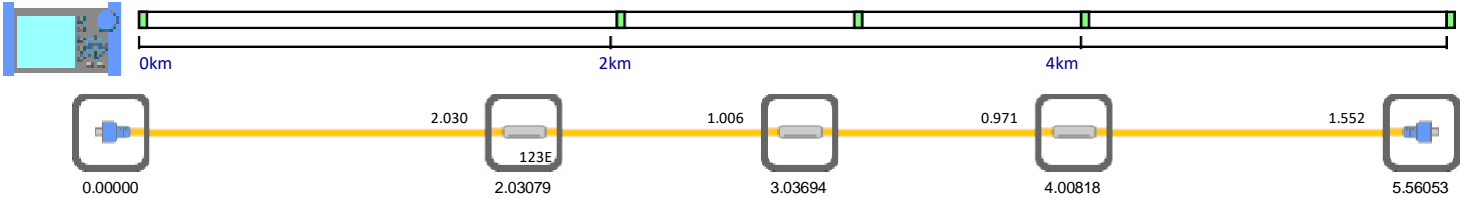



Job Information	
Label: PGCL	Location(A): RCI SIDE GATE
Company Name: SKYLINK MULTIMEDIA	Location(B): TRANSCO 400KV
Name: RCI SIDE GATE TO TRANSCO 400KV	Current Data Flag: BC
Fiber ID: 4F	Supplier Name: Yokogawa Test & Measurement
Fiber Type: Conventional SMF	Model Name: AQ1000 C3YG08010F
Cable ID:	Unit Name:
Cable Code:	FW Ver.: 1.04
Reporting Date: 21/10/2025 14:38	

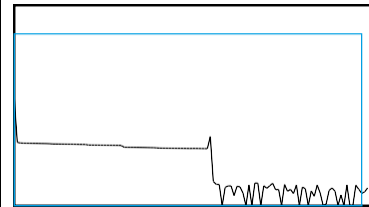

Measure Conditions	
Wavelength:	1550 nm
Distance Range:	10 km
Pulse Width:	200 ns
Attenuation:	Auto
Sample Interval:	2 m
Average Duration:	30 sec
IOR:	1.46000



Event Search Condition	
Splice Loss:	0.10 dB
Return Loss:	70 dB
End of Fiber:	10 dB
Splitter Loss:	----
Backscatter Level:	-52.00 dB
Macro Bending:	----

Event No	Distance (km)	Section (km)	Splice Loss(dB)	Return Loss(dB)	Cumulate Loss(dB)	dB/km	Event Type	Section IOR
1	2.03079		0.128		0.556	0.288		1.46000
2	3.03694	1.00615	0.607		0.866	0.182		1.46000
3	4.00818	0.97124	0.131		1.652	0.184		1.46000
E	5.56053	1.55235		51.056	2.005	0.143		1.46000